

H2S-BH Hydrogen Sulfide Sensor High Sensitivity

45° -


-Worker

Ø32.3 including label



Figure 1 H2S-BH Schematic Diagram

PATENTED

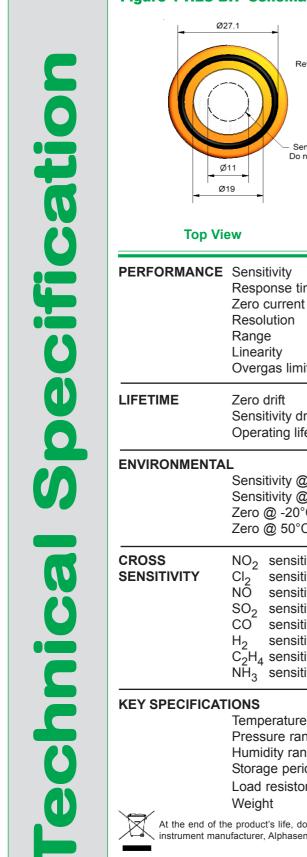

	9 	nensions in millimetres (± 0.1mm)	HYDROGEN SULFIDE H2S-BH 12345678 999 1 recess Ø2.8	3.4
Top Vie	€W	Bottom View	Side View	
FORMANCE	Sensitivity Response time Zero current Resolution Range Linearity Overgas limit	nA/ppm in 20ppm H_2S1 t_{90} (s) from zero to 20ppm H_2S ppm equivalent in zero air RMS noise (ppm equivalent) ppm H_2S limit of performance ppm error at full scale, linear a maximum ppm for stable response	warranty at zero and 20ppm H ₂	1400 to 2100 < 55 < ± 0.15 < 0.02 50 S -1 to -2 200
TIME	Zero drift Sensitivity drift Operating life	ppm equivalent change/year ir % change/year in lab air, mont months until 80% original sign	thly test	< 0.03 < 1 ed) > 24
IRONMENTA		% (output @ -20°C/output @ 2 % (output @ 50°C/output @ 2 ppm equivalent change from 2 ppm equivalent change from 2	0°C) @ 20ppm 20°C	80 to 93 100 to 110 < ± 0.5 < 0 to 1.5
DSS SITIVITY	$\begin{array}{lll} NO_2 & sensitivity \\ Cl_2 & sensitivity \\ NO & sensitivity \\ SO_2 & sensitivity \\ CO & sensitivity \\ H_2 & sensitivity \\ C_2H_4 & sensitivity \\ NH_3 & sensitivity \end{array}$	% measured gas @ 10ppm % measured gas @ 10ppm % measured gas @ 50ppm % measured gas @ 20ppm % measured gas @ 400ppm % measured gas @ 400ppm % measured gas @ 20ppm	$\begin{array}{c} NO_2 \\ CI_2 \\ NO \\ SO_2 \\ CO \\ H_2 \\ C_2H_4 \\ NH_3 \end{array}$	< -20 < -25 < 3 < 15 < 1 < 0.25 < 0.15 < 0.1
SPECIFICAT	IONS			
	Temperature range Pressure range Humidity range Storage period Load resistor Weight	°C kPa % rh continuous months @ 3 to 20°C (stored in Ω (recommended) g	n sealed pot)	-30 to 50 80 to 120 15 to 90 6 10 to 47 < 13
At the end of the	0	g se of any electronic sensor, component of	r instrument in the domestic	

At the end of the product's life, do not dispose of any electronic sensor, component or instrument in the domestic waste, but contact the instrument manufacturer, Alphasense or its distributor for disposal instructions.

NOTE: all sensors are tested at ambient environmental conditions, with 10 ohm load resistor, unless otherwise stated. As applications of use are outside our control, the information provided is given without legal responsibility. Customers should test under their own conditions, to ensure that the sensors are suitable for their own requirements.



H2S-BH Performance Data

Figure 2 SensitivityTemperature Dependence

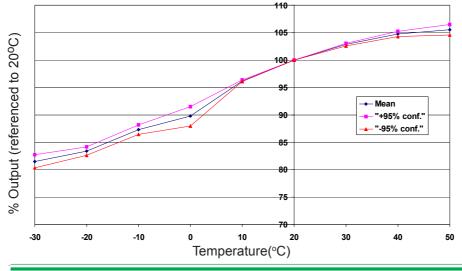


Figure 2 shows the variation in sensitivity caused by changes in temperature.

This data is taken from a typical batch of sensors. The mean and $\pm 95\%$ confidence intervals are shown.

Figure 3 Zero Temperature Dependence

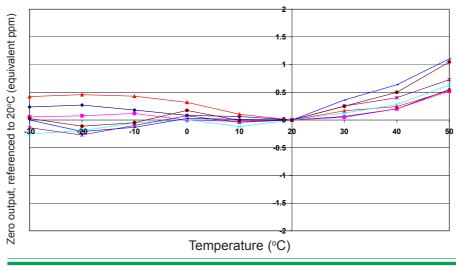


Figure 3 shows the variation in zero output caused by changes in temperature, expressed as ppm gas equivalent, referenced to zero at 20°C.

This data is taken from a typical batch of sensors.

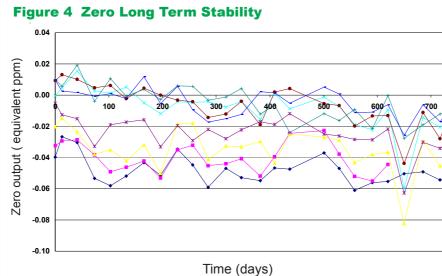


Figure 4 shows the excellent zero stability for the H2S-BH over 2 years, ensuring that low level alarms will remain stable.

For further information on the performance of this sensor, on other sensors in the range or any other subject, please contact Alphasense Ltd. For Application Notes visit "www.alphasense.com".

In the interest of continued product improvement, we reserve the right to change design features and specifications without prior notification. The data contained in this document is for guidance only. Alphasense Ltd accepts no liability for any consequential losses, injury or damage resulting from the use of this document or the information contained within. (©ALPHASENSE LTD) Doc. Ref H2SBH/DEC15